


CT100 Supplemental Instructions

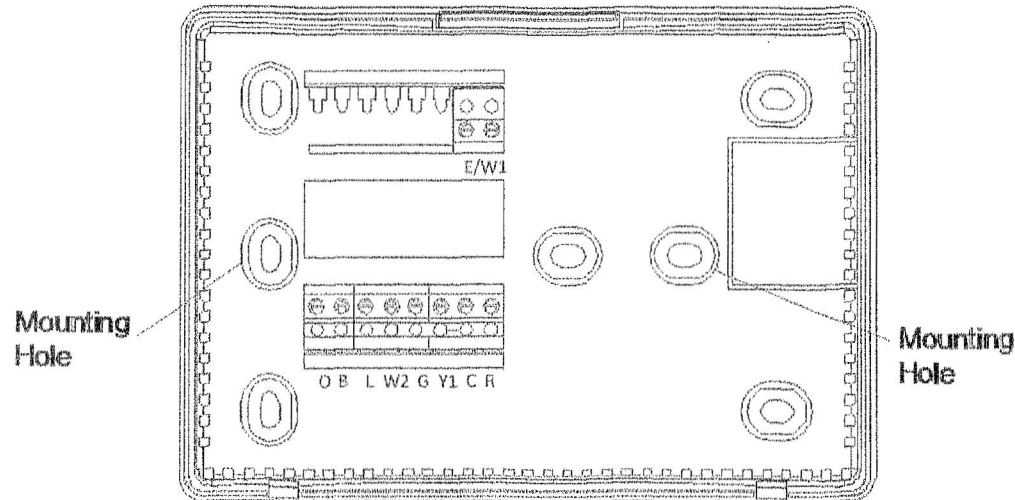

Common Wiring Configurations

- Two wire boilers should be connected to R and W1
- Three wire furnace w/o AC should be connected to R, W1, Y
- Four wire furnace with AC should be connected to R, W1, Y and G

Thermostat Terminals	
R	24v (Hot)
C	24vac (Optional Common)
W1	Heat Relay
Y	Cool Relay
G	Fan Relay

Note: Before removing your old thermostat. Label what wires are connected to which terminals. You should connect the wires to the same terminals on the CT100.